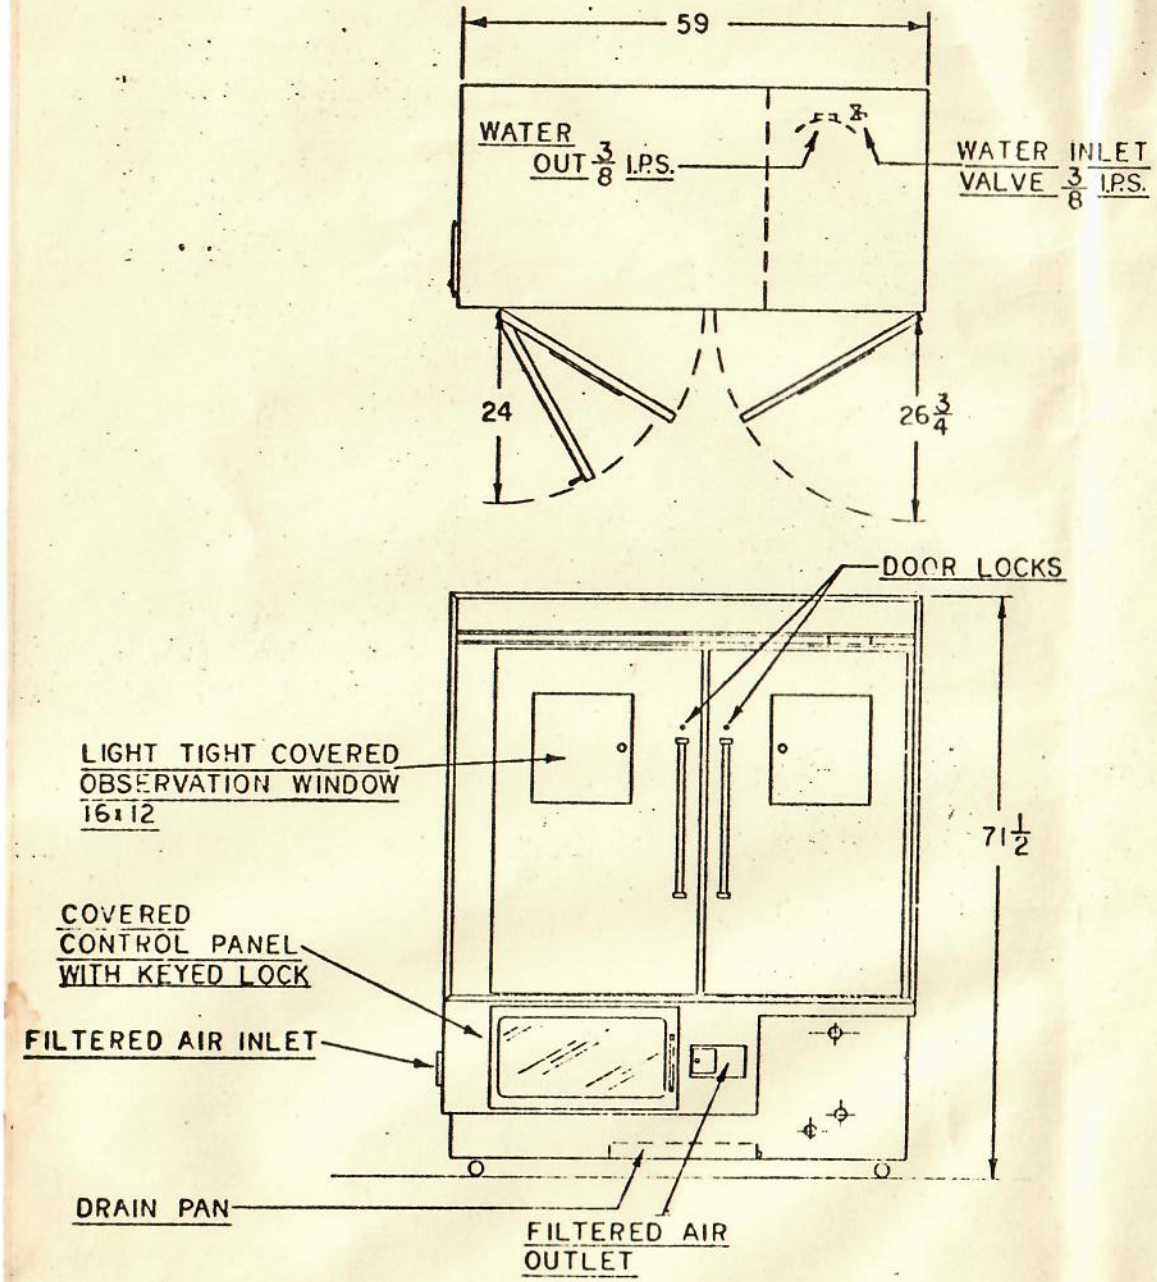

NOTE
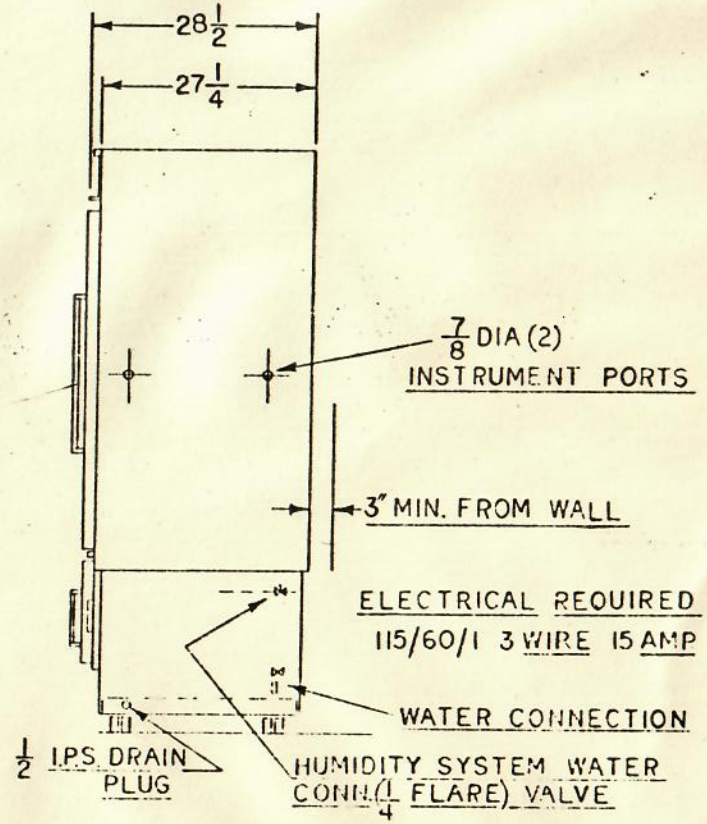
1. AIR COOLED UNITS REQUIRE APPROX. 500 CFM VENTILATION AIR
2. WATER CONNS REQUIRED FOR WATER COOLED UNITS ONLY REQUIRES .5 G.P.M. AT 70°F
3. HUMIDITY SYSTEM OPTIONAL 0.85 G.P.H. AT 40 P.S.I.